

DRAWING KEY


- EXISTING 11KV OVERHEAD LINE
- EXISTING 33KV OVERHEAD LINE
- EXISTING 10KV OVERHEAD LINE
- EXISTING 11KV UNDERGROUND CABLE
- EXISTING 33KV UNDERGROUND CABLE
- PROPOSED UNDERGROUND 11KV CABLE
- PROPOSED UNDERGROUND 33KV CABLE
- 10KV LINE ABOVE GROUND

EXTRA INFORMATION


- WORKING POINT FOR INSTALLATION
- PROTECTIVE LINE
- ACCESSORY ELS UNDER S/S
- CABLE EXPOSURE
- EL EXPOSURE CAB. P. SUCT
- 11KV PIT POSITION
- 33KV PIT POSITION
- EXISTING WATER MAIN
- EXISTING SEWER
- EXISTING RAILWAY LINE

NOTES

1. CABLE ROUTE IS SHOWN IN UNDESIRABLE WHERE POSSIBLE. HOWEVER, IF ON-SITE CONDITIONS DICTATE THAT IS NOT POSSIBLE FOR PRACTICAL OR LEGAL REASONS, THE CABLE CAN BE MOVED INTO THE ROAD.

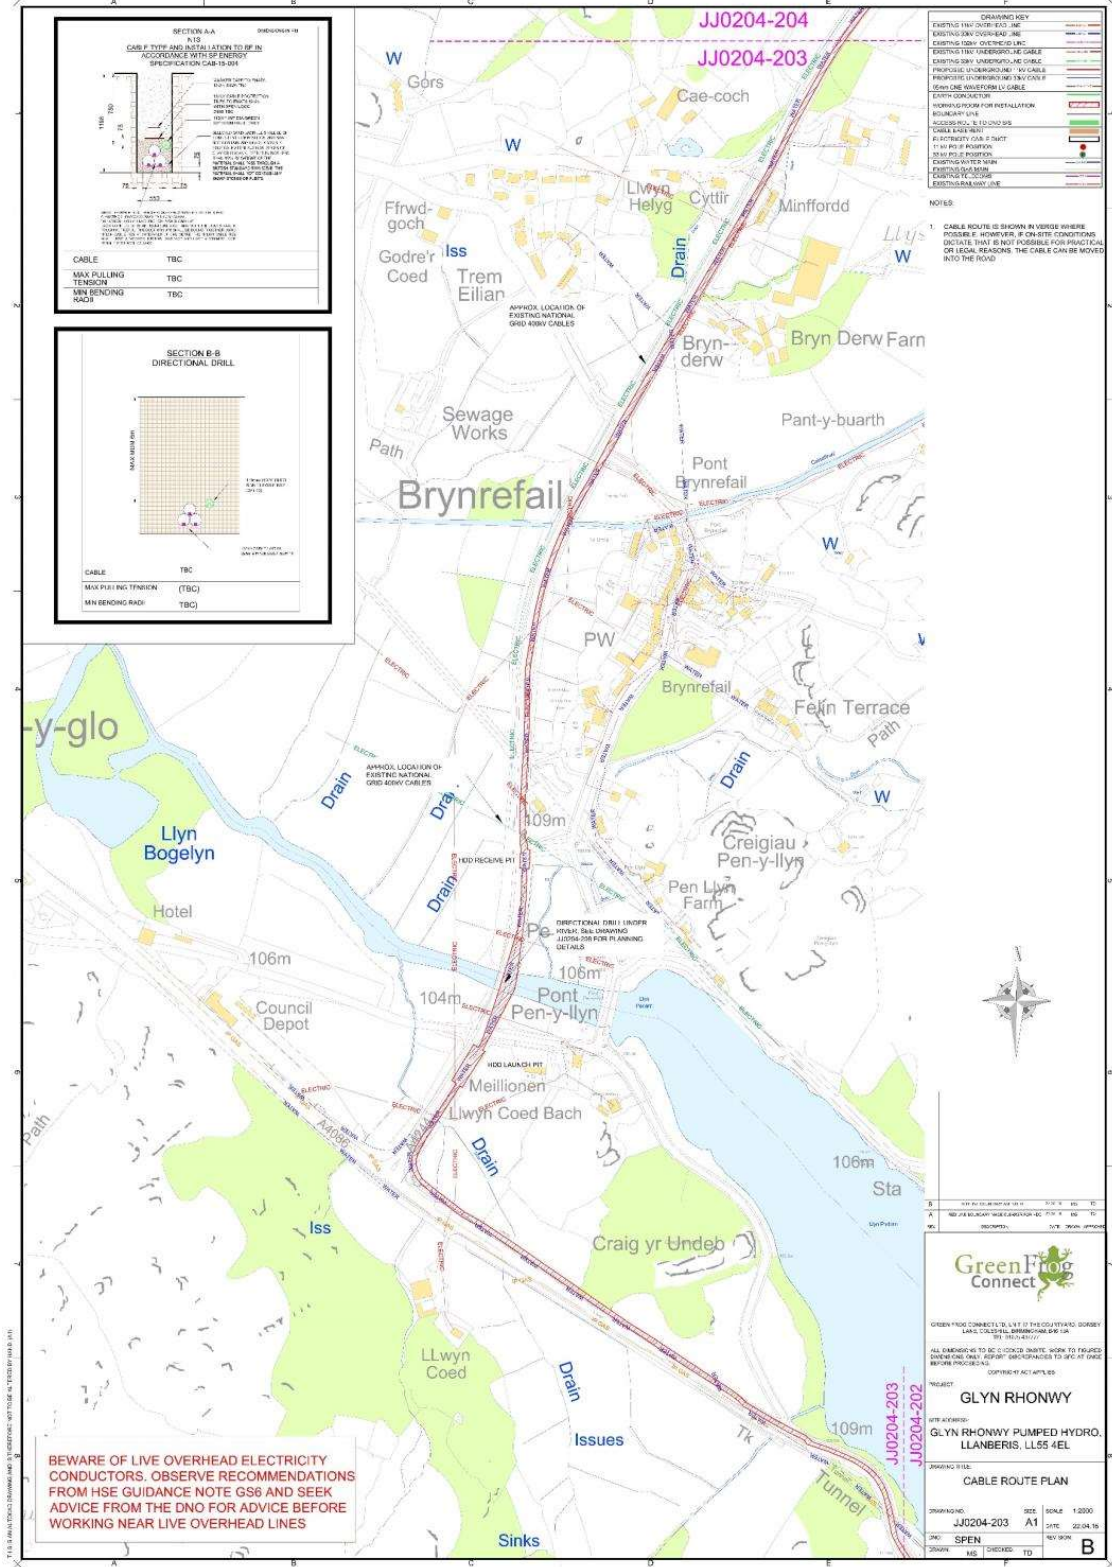

BEWARE OF LIVE OVERHEAD ELECTRICITY CONDUCTORS. OBSERVE RECOMMENDATIONS FROM HSE GUIDANCE NOTE G56 AND SEEK ADVICE FROM THE DNO FOR ADVICE BEFORE WORKING NEAR LIVE OVERHEAD LINES

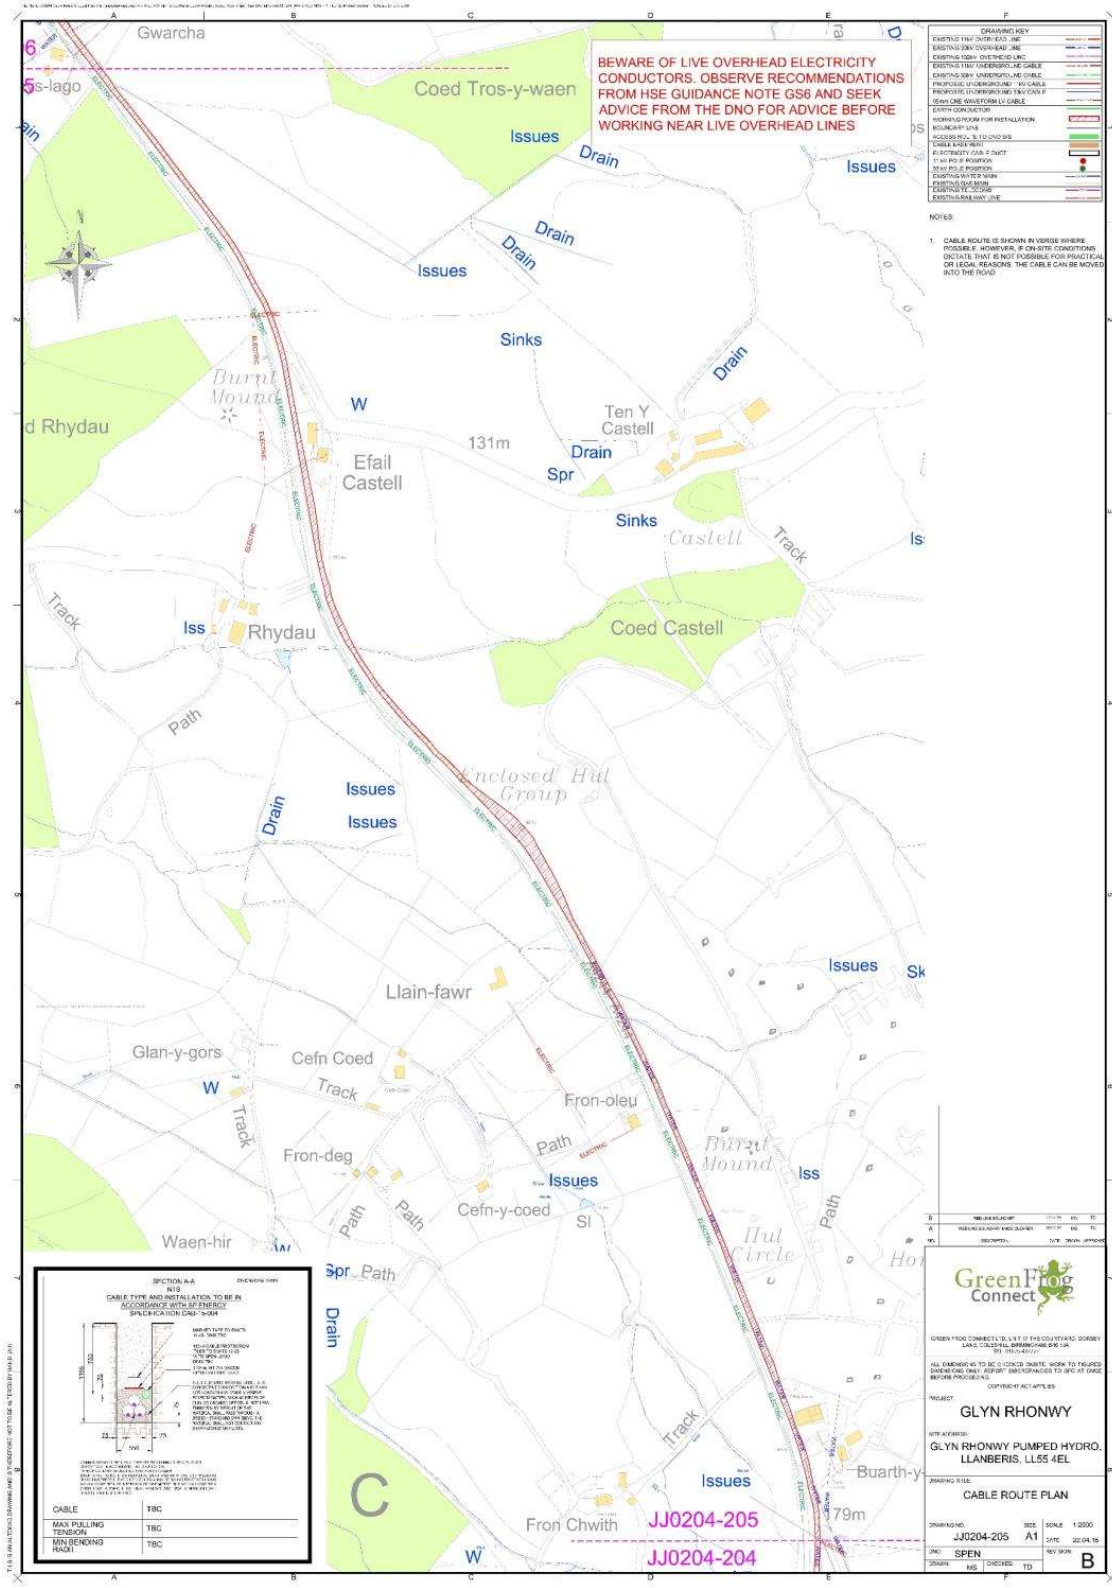


BEWARE OF LIVE OVERHEAD ELECTRICITY CONDUCTORS. OBSERVE RECOMMENDATIONS FROM HSE GUIDANCE NOTE GS6 AND SEEK ADVICE FROM THE DNO FOR ADVICE BEFORE WORKING NEAR LIVE OVERHEAD LINES

DRAWING KEY

EXISTING 11KV OVERHEAD LINE	---
EXISTING 33KV OVERHEAD LINE	---
EXISTING 11KV UNDERGROUND CABLE	---
EXISTING 33KV UNDERGROUND CABLE	---
PROPOSED UNDERGROUND 11KV CABLE	---
PROPOSED UNDERGROUND 33KV CABLE	---
10KV LINE ABOVE GROUND CABLE	---
EXISTING CONDUIT	---
WORKING POOL FOR INSTALLATION	---
MOBILITY LINE	---
ACCESSORY ELECTRICAL SERVICES	---
CABLE EXISTENCE	---
ELECTRICITY CABLE SPLIT	---
11KV PIP POSITION	---
33KV PIP POSITION	---
CONDUIT SPLIT POINT	---
CONDUIT SPLIT POINT	---
CONDUIT SPLIT POINT	---
EXISTING RAILWAY LINE	---

NOTES

1. CABLE ROUTE IS SHOWN IN RED WHERE POSSIBLE. HOWEVER, IF ON-SITE CONDITIONS DICTATE THAT IS NOT POSSIBLE FOR PRACTICAL OR LEGAL REASONS, THE CABLE CAN BE MOVED INTO THE ROAD.

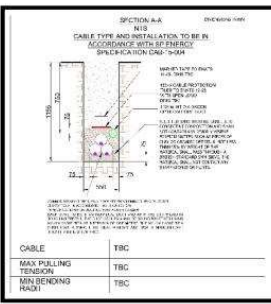

GreenFrog Connect

GREEN FROG CONNECT IS A DIV OF THE COLTYNARD BOROUGH LAND-CASTELL ENVIRONMENTALIA

ALL CHANGES TO BE CHECKED DATE, WORK TO BE DONE DURING ONE ONLY REPORT DISCREPANCIES TO SPEC AT ONCE BEFORE PROCEEDING

CONTRACT ACT/PT/LS

PROJECT
GLYN RHONWY

SITE ADDRESS
GLYN RHONWY PUMPED HYDRO, LLANBERIS, LL55 4EL


DRAWING TITLE
CABLE ROUTE PLAN

2024/04/04 **SCALE** 1:2000

JJ0204-205 **A1** **DATE** 22/04/24

SPEN **REV** NONE

STATUS **MS** **CHECKED** **TD**

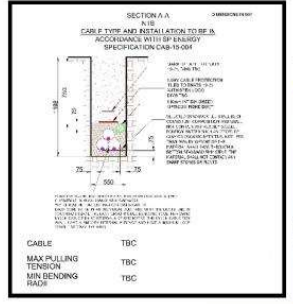


BEWARE OF LIVE OVERHEAD ELECTRICITY CONDUCTORS. OBSERVE RECOMMENDATIONS FROM HSE GUIDANCE NOTE GS6 AND SEEK ADVICE FROM THE DNO FOR ADVICE BEFORE WORKING NEAR LIVE OVERHEAD LINES

CABLE	TBC
MAX PULLING TENSION	TBC
MIN BENDING RADIUS	TBC

DRAWING KEY	
EXISTING 11KV OVERHEAD LINE	
EXISTING 33KV OVERHEAD LINE	
EXISTING 10KV OVERHEAD LINE	
EXISTING 11KV UNDERGROUND CABLE	
EXISTING 33KV UNDERGROUND CABLE	
PROPOSED UNDERGROUND 11KV CABLE	
PROPOSED UNDERGROUND 33KV CABLE	
PROPOSED UNDERGROUND 10KV CABLE	
PROPOSED 11KV OVERHEAD LINE	
PROPOSED 33KV OVERHEAD LINE	
PROPOSED 10KV OVERHEAD LINE	
EXISTING CONDUIT	
WORKING POOL FOR INSTALLATION	
MOISTURE LINE	
ACCESSORY ELECTRICAL SERVICES	
CABLE EXHAUST	
ELECTRICITY CAB. P. SHEET	
11KV PIP POSITION	
33KV PIP POSITION	
EXISTING 11KV MAN	
EXISTING 33KV MAN	
EXISTING 10KV MAN	
EXISTING 11KV JUNCTION	
EXISTING 33KV JUNCTION	
EXISTING 10KV JUNCTION	

NOTES:
1. CABLE ROUTE IS SHOWN IN RED WHERE POSSIBLE. HOWEVER, IF ON-SITE CONDITIONS INDICATE THAT IS NOT POSSIBLE FOR PRACTICAL OR LEGAL REASONS, THE CABLE CAN BE MOVED INTO THE ROAD.

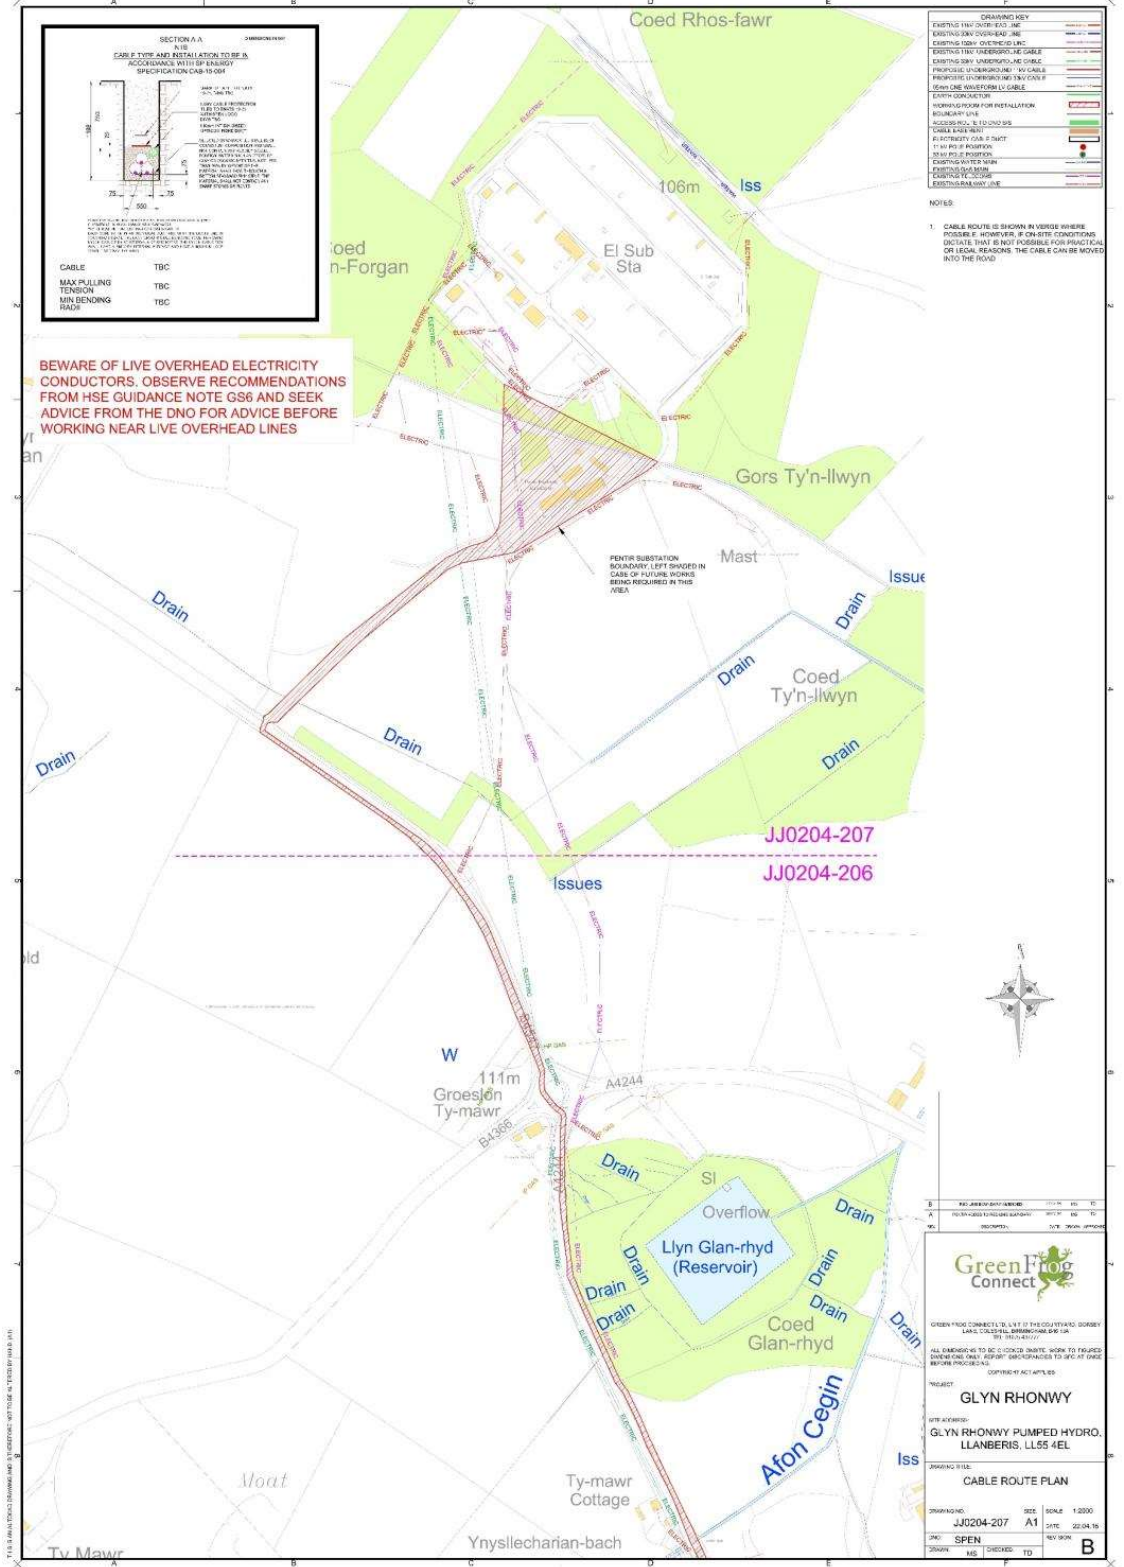

GreenFrog Connect

GREEN FROG CONNECT IS A DIV OF THE COLTARTHO BORDYR LAND-CARELL, BANGOR, LL57 2YU

ALL CHANGES TO BE CONFIRMED BY WORK TO BE CARRIED OUT. ONLY REPORT DISCREPANCIES TO SPEC AT ONCE BEFORE PROCEEDING.

PROJECT: Glyn Rhonwy

SITE ADDRESS: Glyn Rhonwy Pumped Hydro, Llanberis, LL55 4EL

DRAWING TITLE: CABLE ROUTE PLAN

DATE: 22/04/15

SCALE: 1:2000

JJ0204-207 A1

SPEN

MS

TD

B



